


D2 W GMD

Installation Guide

FCC Notice

This device complies with Part 15.247 of the FCC Rules. Operation is subject to the following two conditions:
 1) This device may not cause harmful interference and
 2) This device must accept any interference received, including interference that may cause undesired operation

Aerial Installation

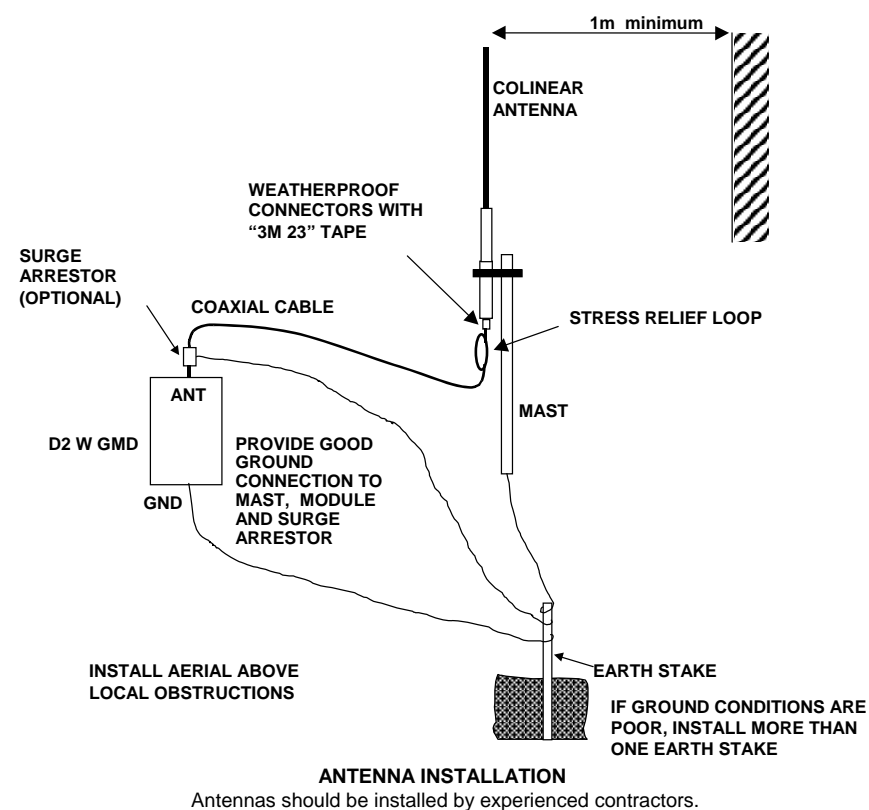

D2 W GMD Installation

Power supply: (A) 12-24VAC 16VA CSA Certified Class 2
 (B) 9-30VDC 16VA CSA Certified Class 2
 (C) 13.8V Lead Acid Battery or Gel-cell

Choose option and wire as shown

WARNING !

EXPLOSION HAZARD

DO NOT DISCONNECT WHILE CIRCUIT IS LIVE UNLESS AREA IS KNOWN TO BE NON HAZARDOUS

NOTES

- DIO channels can be wired as either inputs or outputs.
- All I/O must be SELV.

CAUTION!

For continued protection against risk of fire, replace the module fuse only with the same type and rating

